
# atos


# **Digital proportional pressure cartridges**

piloted, without transducer - compensator, relief, reducing functions

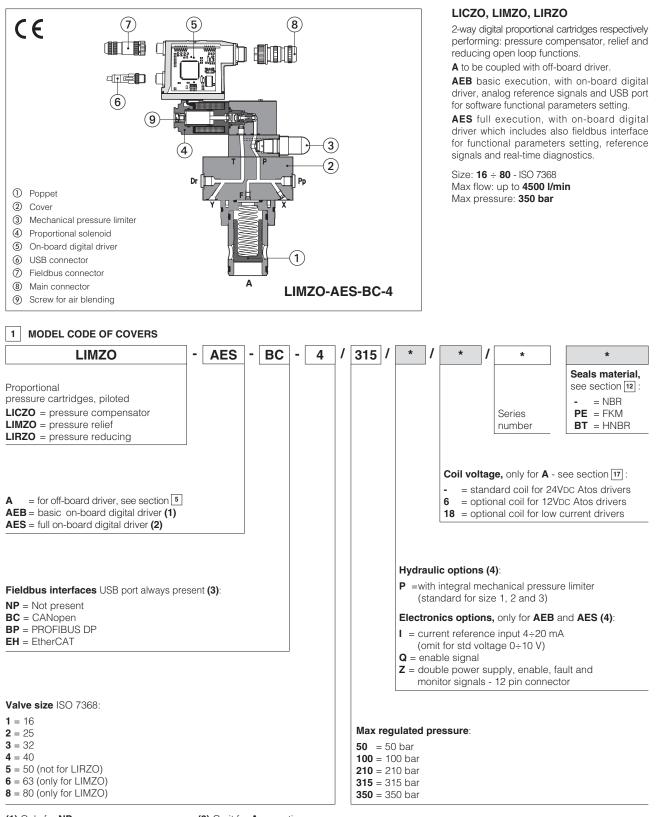

(1) Only for NP(2) Only for BC, BP, EH

(3) Omit for A execution(4) For possible combined options, see section 16

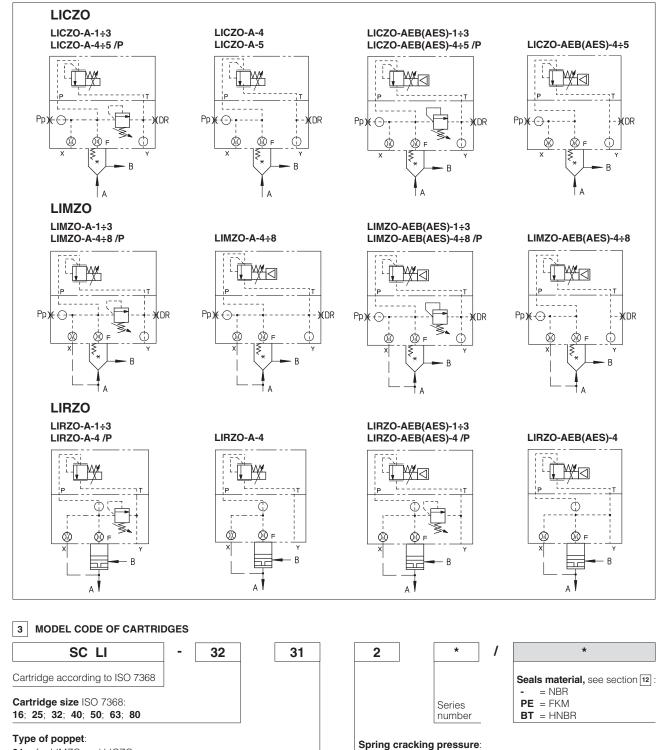

**31** = for LIMZO and LICZO **36** = for LICZO

**37** = for LIRZO

**6** = 6 bar for poppet 31 and 36 **7** = 7 bar for poppet 37

# 4 TYPE OF POPPET

Type of poppet	31	36	37
Functional sketch (Hydraulic symbol)			
Typical section			
Area ratio A: AP	1:1	1:1	1:1

**2** = 1,5 bar for poppet 31 **3** = 3 bar

**4** = 4 bar

#### 5 OFF-BOARD ELECTRONIC DRIVERS - only for A

Drivers model	E-MI-A	AC-01F	E-MI-AS-IR		E-BM-AS-PS		E-BM-AES	
Туре	Ana	alog		Digital				
Voltage supply (VDC)	12	24	12	24	12	24	24	
Valve coil option	/6	std	/6	std	/6	std	std	
Format		plug-in to	o solenoid		DIN-rai		panel	
Tech table	GC	)10	G020		G030		GS050	

## 6 GENERAL NOTES

Atos digital proportionals valves are CE marked according to the applicable directives (e.g. Immunity and Emission EMC Directive). Installation, wirings and start-up procedures must be performed according to the general prescriptions shown in tech table **FS900** and in the user manuals included in the E-SW-\* programming software.

#### 7 VALVE SETTINGS AND PROGRAMMING TOOLS

Valve's functional parameters and configurations, can be easily set and optimized using Atos E-SW programming software connected via USB port to the digital driver (see table **FS900**). For fieldbus versions, the software permits valve's parameterization through USB port also if the driver is connected to the central machine unit via fieldbus.

The software is available in different versions according to the driver's options (see table **GS500**): **F-SW-RASIC** Support NP (LISB) PS (Serial) IR (Infrared)

E-011-DA010	support.		10(001101)	in (in marcu)
E-SW-FIELDBUS	support:	BC (CANopen)	BP (PROFIBUS DP)	EH (EtherCAT)
		EW (POWERLINK)	EI (EtherNet/IP)	EP (PROFINET)
E-SW-*/PQ	support:	valves with SP, SF, S	SL alternated control (e	e.g. E-SW-BASIC/PQ)

E-A-SB-USB/OPT isolator

E-C-SB-USB/M12 cable

E-A-SB-USB/BTH adapter

WARNING: drivers USB port is not isolated! For E-C-SB-USB/M12 cable, the use of isolator adapter is highly recommended for PC protection

WARNING: see tech table GS500 for the list of countries where the Bluetooth adapter has been approved

#### 8 FIELDBUS - only for AES, see tech. table GS510

Fieldbus allows valve direct communication with machine control unit for digital reference, valve diagnostics and settings. These execution allow to operate the valves through fieldbus or analog signals available on the main connector.

#### 9 GENERAL CHARACTERISTICS

Assembly position	Any position						
Subplate surface finishing to ISO 4401	Acceptable roughness index: Ra $\leq$ 0,8, recommended Ra 0,4 – Flatness ratio 0,01/100						
MTTFd valves according to EN ISO 13849	75 years, see technical table P007						
Ambient temperature range	A:Standard = $-20^{\circ}$ C $\div +70^{\circ}$ C/PE option = $-20^{\circ}$ C $\div +70^{\circ}$ C/BT option = $-40^{\circ}$ C $\div +60^{\circ}$ CAEB, AES:Standard = $-20^{\circ}$ C $\div +60^{\circ}$ C/PE option = $-20^{\circ}$ C $\div +60^{\circ}$ C/BT option = $-40^{\circ}$ C $\div +60^{\circ}$ C						
Storage temperature range	A:Standard = $-20^{\circ}$ C $\div +80^{\circ}$ C/PE option = $-20^{\circ}$ C $\div +80^{\circ}$ C/BT option = $-40^{\circ}$ C $\div +70^{\circ}$ CAEB, AES:Standard = $-20^{\circ}$ C $\div +70^{\circ}$ C/PE option = $-20^{\circ}$ C $\div +70^{\circ}$ C/BT option = $-40^{\circ}$ C $\div +70^{\circ}$ C						
Surface protection	Zinc coating with black passivation, galvanic treatment (driver housing for AEB and AES)						
Corrosion resistance	Salt spray test (EN ISO 9227) > 200 h						
Compliance	CE according to EMC directive 2014/30/EU (Immunity: EN 61000-6-2; Emission: EN 61000-6-3) RoHS Directive 2011/65/EU as last update by 2015/65/EU REACH Regulation (EC) n°1907/2006						

#### 10 HYDRAULIC CHARACTERISTICS - based on mineral oil ISO VG 46 at 50 °C

Valve model			LICZO			LIMZO					LIRZO						
valve size		1	2	3	4	5	1	2	3	4	5	6	8	1	2	3	4
Max flow	[l/min]	200	400	750	1000	2000	200	400	750	1000	2000	3000	4500	160	300	550	800
Min regulated pres. at port A [bar]		9	9 8,5 8 13 15 7 7 7 10,5 12 12 <b>(2)</b>		7												
Min regulated pres. at port A for /	350 [bar]	11 10 10 13 16 10 10 9 12 13 13 16		16	12												
Max regulated pres. at port A	[bar]	50; 100; 210; 315; 350			50; 100; 210; 315; 350						50; 100; 210; 315; 350						
Response time 0-100% step signal [ms]		100 ÷ 400			100 ÷ 450					100 ÷ 350							
Hysteresis [% of the regulated max flow]		≤2			≤ 1,5					≤2							
Linearity [% of the regulated max flow]		≤3			≤3					≤3							
Repeatability [% of the regulated	max flow]			≤2			≤2					≤2					

Note: above performance data refer to valves coupled with Atos electronic drivers, see section 5

(1) Average response time value; the pressure variation in consequence of a modification of the reference input signal to the valve is affected by the stiffness of the hydraulic circuit: greater is the stiffness of the circuit, faster is the dynamic response.

(2) Consult our techincal office.

#### USB or Bluetooth connection

AES

# 11 ELECTRICAL CHARACTERISTICS

Power supplies	Nominal Rectified and filtered	: +24 VDC : VRMS = 20 ÷ 32 VMAX	(ripple max 10 % VPP)				
Max power consumption	<b>A</b> = 30 W	<b>AEB</b> , <b>AES</b> = 50 W					
Coil voltage code	standard		option /6	option /18			
Max. solenoid current	2,6 A		3,25 A	1,5 A			
Coil resistance R at 20°C	3 ÷ 3,3 Ω		2 ÷ 2,2 Ω	13 ÷ 13,4 Ω			
Analog input signals	Voltage: range ±10 V Current: range ±20 m	( /	Input impedance Input impedance				
Monitor output	Output range: vo	ltage ±5 VDC @ max	s 5 mA				
Enable input	Range: 0 ÷ 9 VDC (OFF	state), 15 ÷ 24 VDC (ON	state), 9 ÷ 15 VDC (not ac	cepted); Input impedance: Ri > 87 k $\Omega$			
Fault output		Output range : $0 \div 24$ VDC (ON state $\cong$ VL+ [logic power supply] ; OFF state $\cong$ 0 V) @ max 50 mA; external negative voltage not allowed (e.g. due to inductive loads)					
Alarms			eak with current referend	ce signal, over/under temperature, failure (/W option)			
Insulation class			tures of the solenoid coi 982 must be taken into a				
Protection degree to DIN EN60529	A = IP65; AEB, AES =	IP66 / IP67 with mating	g connectors				
Duty factor	Continuous rating (ED=	=100%)					
Tropicalization	Tropical coating on ele	ectronics PCB					
Additional characteristics		of solenoid's current serve polarity of power se		P.I.D. with rapid solenoid switching;			
Communication interface	USB Atos ASCII coding	CANopen EN50325-4 + DS408	PROFIBUS DP EN50170-2/IEC61158	EtherCAT EC 61158			
Communication physical layer	not insulated USB 2.0 + USB OTG	optical insulated CAN ISO11898	optical insulated RS485	Fast Ethernet, insulated 100 Base TX			
Recommended wiring cable	LiYCY shielded cables	, see section 21	1	1			


Note: a maximum time of 500 ms (depending on communication type) have be considered between the driver energizing with the 24 V<sub>DC</sub> power supply and when the valve is ready to operate. During this time the current to the valve coils is switched to zero.


#### 12 SEALS AND HYDRAULIC FLUIDS - for other fluids not included in below table, consult our technical office

		NBR seals (standard) = -20°C ÷ +60°C (+80°C for A), with HFC hydraulic fluids = -20°C ÷ +50°C					
Seals, recommended fluid temperature		FKM seals (/PE option) = $-20^{\circ}C \div +80^{\circ}C$					
		HNBR seals (/BT option) = -40°C $\div$ +60°C, with HFC hydraulic fluids = -40°C $\div$ +50°C					
Recommended viscosity		20 ÷ 100 mm²/s - max allowed range 15 ÷ 380 mm²/s					
Max fluid	normal operation	ISO4406 class 18/16/13 NAS1	see also filter section at				
contamination level	longer life	ISO4406 class 16/14/11 NAS1	www.atos.com or KTF catalog				
Hydraulic fluid		Suitable seals type	Classification	Ref. Standard			
Mineral oils		NBR, FKM, HNBR	HL, HLP, HLPD, HVLP, HVLPD	DIN 51524			
Flame resistant without water		FKM HFDU, HFDR		ISO 12922			
Flame resistant with water		NBR, HNBR	HFC	130 12922			

#### 13 DIAGRAMS (based on mineral oil ISO VG 46 at 50 °C)


- Regulation diagrams LIMZO Regulation diagrams LICZO 1
- 2
- Pressure/flow diagrams LICZO, LIMZO 3







#### 4-14 Min. pressure/flow diagrams

	reference	







#### **Regulation diagrams LIRZO**


#### 15= LIRZO-A


#### 16-19 Min. pressure/flow diagrams with reference signal "null"

16= LIRZO-*-1
17 = LIRZO-*-2
18= LIRZO-*-3
19= LIRZO-*-4

#### Pressure/flow diagrams

20 = LIRZO-A



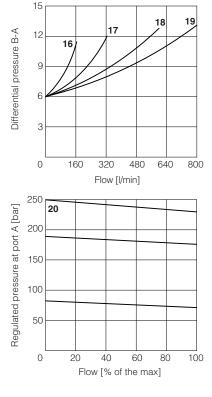


#### 14 HYDRAULIC OPTIONS

P = This option (standard for size 1, 2 and 3) provides a mechanical pressure limiter acting as protection against overpressure. For safety reasons the factory setting of the mechanical pressure limiter is fully unloaded (min pressure).

At the first commissioning it must be set at a value lightly higher than the max pressure regulated with the proportional control.

For the pressure setting of the mechanical pressure limiter, proceed according to following steps:

- apply the max reference input signal to the valve's driver. The system pressure will not increase until the mechanical pressure limiter remains unloaded
- turn clockwise the adjustment screw () until the system pressure will increase up to a stable value corresponding to the pressure setpoint at max reference input signal
- turn clockwise the adjustment screw (1) of additional 1 or 2 turns to ensure that the mechanical pressure limiter remains closed during the proportional valve working



#### 15 ELECTRONIC OPTIONS - only for AEB and AES

- This option provides 4 ÷ 20 mA current reference and monitor signals, instead of the standard 0 ÷ 10 VDC.
  Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of ±10 VDC or ±20 mA.
  It is normally used in case of long distance between the machine control unit and the valve or where the reference signal can be affected by electrical noise; the valve functioning is disabled in case of reference signal cable breakage.
- Q = This option permits to inhibit the valve function without removing the power supply to the driver. Upon disable command the current to the solenoid is zeroed and the valve's spool moves to rest position.
  The option /Q is suggested for all cases where the valve has to be frequently inhibited during the machine cycle see 19.5 for signal specifications.
- Z = This option provides, on the 12 pin main connector, the following additional features:
  Fault output signal see 19.6
  Enable input signal see above option /Q
  Power supply for driver's logics and communication see 19.2

#### 16 POSSIBLE COMBINED OPTIONS


Hydraulic options: all combination possible Electronics options: /IQ, /IZ

#### 17 COIL VOLTAGE OPTIONS - only for A

- 6 = Optional coil to be used with Atos drivers with power supply 12 VDC.
- 18 = Optional coil to be used with electronic drivers not supplied by Atos.

#### 18 AIR BLEEDING

At the first valve commissioning the air eventually trapped inside the solenoid must be bled-off though the screw ① located at the rear side of the solenoid housing. The presence of air may cause pressure instability and vibrations.



#### 19 POWER SUPPLY AND SIGNALS SPECIFICATIONS - only for AEB and AES

Generic electrical output signals of the valve (e.g. fault or monitor signals) must not be directly used to activate safety functions, like to switch-ON/OFF the machine's safety components, as prescribed by the European standards (Safety requirements of fluid technology systems and components-hydraulics, ISO 4413).

#### 19.1 Power supply (V+ and V0)

The power supply must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers. In case of separate power supply see 19.2.

A safety fuse is required in series to each power supply: 2,5 A time lag fuse.

#### 19.2 Power supply for driver's logic and communication (VL+ and VL0) - only for /Z option

The power supply for driver's logic and communication must be appropriately stabilized or rectified and filtered: apply at least a 10000  $\mu$ F/40 V capacitance to single phase rectifiers or a 4700  $\mu$ F/40 V capacitance to three phase rectifiers.

The separate power supply for driver's logic on pin 9 and 10, allow to remove solenoid power supply from pin 1 and 2 maintaining active the diagnostics, USB and fieldbus communications.

🚹 A safety fuse is required in series to each driver's logic and communication power supply: 500 mA fast fuse.

#### 19.3 Reference input signal (INPUT+)

The driver controls in closed loop the current to the valve proportionally to the external reference input signal. Reference input signal is factory preset according to selected valve code, defaults are  $0 \div 10$  Vbc for standard and  $4 \div 20$  mA for /l option. Input signal can be reconfigured via software selecting between voltage and current, within a maximum range of  $\pm 10$  Vbc or  $\pm 20$  mA. Drivers with fieldbus interface (BC, BP, EH) can be software set to receive reference signal directly from the machine control unit (fieldbus reference). Analog reference input signal can be used as on-off commands with input range  $0 \div 24$ Vbc.

#### 19.4 Monitor output signal (MONITOR)

The driver generates an analog output signal (MONITOR) proportional to the actual coil current of the valve; the monitor output signal can be software set to show other signals available in the driver (e.g. analog reference, fieldbus reference). Monitor output signal is factory preset according to selected valve code, default settings is  $\pm 5$  Vpc (1V = 1A). Output signal can be reconfigured via software, within a maximum range of  $0 \div 5$  Vpc.

#### 19.5 Enable input signal (ENABLE) - not for standard

To enable the driver, supply a 24 Vbc on pin 3 (pin C): Enable input signal allows to enable/disable the current supply to the solenoid, without removing the electrical power supply to the driver; it is used to active the communication and the other driver functions when the valve must be disabled for safety reasons. This condition **does not comply** with norms IEC 61508 and ISO 13849. Enable input signal can be used as generic digital input by software selection.

#### 19.6 Fault output signal (FAULT) - only for /Z option

Fault output signal indicates fault conditions of the driver (solenoid short circuits/not connected, reference signal broken for 4 ÷ 20 mA input, etc.). Fault presence corresponds to 0 Vpc, normal working corresponds to 24 Vpc. Fault status is not affected by the Enable input signal.

# 20 ELECTRONIC CONNECTIONS

# 20.1 Main connector signals - 7 pin $\widehat{(A1)}\,$ Standard and /Q option - for AEB and AES

PIN	Standard	/Q	TECHNICAL SPECIFICATIONS	NOTES
А	V+		Power supply 24 Vbc	Input - power supply
В	V0		Power supply 0 VDc	Gnd - power supply
С	AGND		Analog ground	Gnd - analog signal
0		ENABLE	Enable (24 Vbc) or disable (0 Vbc) the driver, referred to V0	Input - on/off signal
D	INPUT+		Reference input signal: $\pm 10 \text{ Vbc} / \pm 20 \text{ mA}$ maximum range Defaults are $0 \div 10 \text{ Vbc}$ for standard and $4 \div 20 \text{ mA}$ for /I option	Input - analog signal Software selectable
E	INPUT-		Negative reference input signal for INPUT+	Input - analog signal
F	MONITOR referred to:AGNDV0		Monitor output signal: ±5 Vpc maximum range Default is 0 ÷ 5 Vpc (1V = 1A)	Output - analog signal Software selectable
G	G EARTH		Internally connected to driver housing	

# 20.2 Main connector signals - 12 pin A2 /Z option - for AEB and AES

PIN	/Z	TECHNICAL SPECIFICATIONS	NOTES
1	V+	Power supply 24 Vbc	Input - power supply
2	V0	Power supply 0 Vbc	Gnd - power supply
3	ENABLE	Enable (24 Vbc) or disable (0 Vbc) the driver, referred to VL0	Input - on/off signal
4	4      INPUT+      Reference input signal: ±10 Vpc / ±20 mA maximum range Defaults are 0 ÷ 10 Vpc for standard and 4 ÷ 20 mA for /l option		
5	INPUT-	Negative reference input signal for INPUT+	Input - analog signal
6	MONITOR	Monitor output signal: ±5 Vpc maximum range, referred to VL0 Default is 0 ÷ 5 Vpc (1V = 1A)	Output - analog signal <b>Software selectable</b>
7	NC	Do not connect	
8	NC	Do not connect	
9	VL+	Power supply 24 Vpc for driver's logic and communication	Input - power supply
10	VL0	Power supply 0 Vpc for driver's logic and communication	Gnd - power supply
11	FAULT	Fault (0 Vbc) or normal working (24 Vbc), referred to VL0	Output - on/off signal
PE	EARTH	Internally connected to driver housing	

Note: do not disconnect VL0 before VL+ when the driver is connected to PC USB port

# 20.3 Communication connectors - for AEB B and AES B - C

В	B USB connector - M12 - 5 pin always present				
PIN	SIGNAL	TECHNICAL SPECIFICATION (1)			
1	+5V_USB	Power supply			
2	ID	Identification			
3	GND_USB	Signal zero data line			
4	D-	Data line -			
5	D+	Data line +			

C2	BP fieldbus execution, connector - M12 - 5 pin (2)				
PIN	SIGNAL TECHNICAL SPECIFICATION (1)				
1	+5V	Termination supply signal			
2	LINE-A	Bus line (high)			
3	DGND	Data line and termination signal zero			
4	LINE-B	Bus line (low)			
5	SHIELD	ELD			

(1) Shield connection on connector's housing is recommended

# **20.4 Solenoid connection** - only for $\boldsymbol{\mathsf{A}}$


PIN	SIGNAL	TECHNICAL SPECIFICATION	Connector code 666		
1	COIL	Power supply			
2	COIL	Power supply			
3	GND	Ground			

©1)	C1 BC fieldbus execution, connector - M12 - 5 pin (2)				
PIN	SIGNAL	SIGNAL TECHNICAL SPECIFICATION (1)			
1	CAN_SHLD	Shield			
2	NC	do not connect			
3	CAN_GND	AN_GND Signal zero data line			
4	CAN_H	Bus line (high)			
5	CAN_L	Bus line (low)			


<b>C</b> 3	C3 C4 EH fieldbus execution, connector - M12 - 4 pin (2)				
PIN	SIGNAL	SIGNAL TECHNICAL SPECIFICATION (1)			
1	TX+ Transmitter				
2	RX+ Receiver				
3	TX- Transmitter				
4	RX- Receiver				
Housing	SHIELD				

(2) Only for AES execution

#### 20.5 AEB connections layout

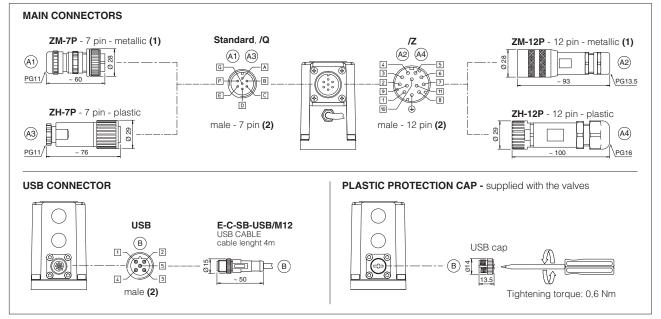

(1) Use of metallic connectors is strongly recommended in order to fulfill EMC requirements (2) Pin layout always referred to driver's view

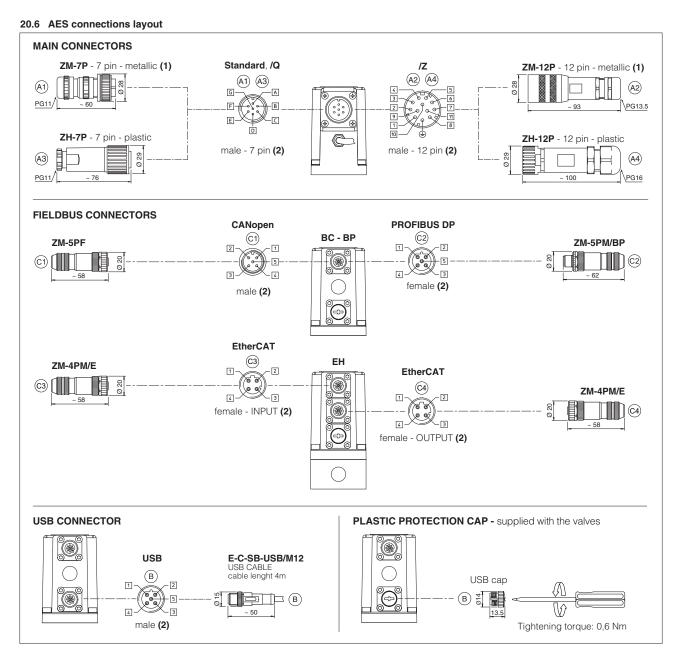

#### (1) Use of metallic connectors is strongly recommended in order to fulfill EMC requirements

(2) Pin layout always referred to driver's view

## 21 CONNECTORS CHARACTERISTICS - to be ordered separately

CONNECTOR TYPE	POWER SUPPLY	POWER SUPPLY		
CODE	(A1) ZM-7P	A3 ZH-7P		
Туре	7pin female straight circular	7pin female straight circular		
Standard	According to MIL-C-5015	According to MIL-C-5015		
Material	Metallic	Plastic reinforced with fiber glass		
Cable gland	PG11	PG11		
Recommended cable	LiYCY 7 x 0,75 mm <sup>2</sup> max 20 m (logic and power supply) or LiYCY 7 x 1 mm <sup>2</sup> max 40 m (logic and power supply)	LiYCY 7 x 0,75 mm <sup>2</sup> max 20 m (logic and power supply) or LiYCY 7 x 1 mm <sup>2</sup> max 40 m (logic and power supply)		
Conductor size	up to 1 mm <sup>2</sup> - available for 7 wires	up to 1 mm <sup>2</sup> - available for 7 wires		
Connection type	to solder	to solder		
Protection (EN 60529)	IP 67	IP 67		

# 21.2 Main connectors - 12 pin - for AEB and AES

CONNECTOR TYPE	POWER SUPPLY	POWER SUPPLY		
CODE	(A2) ZM-12P	(A4) ZH-12P		
Туре	12pin female straight circular	12pin female straight circular		
Standard	DIN 43651	DIN 43651		
Material	Metallic	Plastic reinforced with fiber glass		
Cable gland	PG13,5	PG16		
Recommended cable	LiYCY 12 x 0,75 mm <sup>2</sup> max 20 m (logic and power supply)	LiYCY 10 x 0,14mm² max 40 m (logic) LiYY 3 x 1mm² max 40 m (power supply)		
Conductor size	0,5 mm <sup>2</sup> to 1,5 mm <sup>2</sup> - available for 12 wires	0,14 mm² to 0,5 mm² - available for 9 wires 0,5 mm² to 1,5 mm² - available for 3 wires		
Connection type	to crimp	to crimp		
Protection (EN 60529) IP 67		IP 67		

#### 21.3 Fieldbus communication connectors - only for AES

CONNECTOR TYPE	BC CANopen (1)		BP PROFIBUS DP (1)		EH EtherCAT (2)	
CODE	C1 ZM-5PF	C2 ZM-5PM	C1 ZM-5PF/BP	C2 ZM-5PM/BP	C1 C2	ZM-4PM/E
Туре	5 pin female straight circular	5 pin male straight circular			4 pin male straight circular	
Standard	tandard M12 coding A – IEC 61076-2-101 M12 coding B – IEC 61076-2-101 M12 codin		ding D – IEC 61076-2-101			
Material	Me	tallic	Metallic			Metallic
Cable gland	Pressure nut - cab	e diameter 6÷8 mm	Pressure nut - cable diameter 6÷8 mm		Pressure nut - cable diameter 4÷8 mm	
Cable	CANbus Stand	lard (DR 303-1) PROFIBUS DP Standard		Ethe	ernet standard CAT-5	
Connection type screw terminal		screw terminal		terminal block		
Protection (EN 60529)	IF	67	IP 67 IP 67		IP 67	


(1) E-TRM-\*\* terminators can be ordered separately - see tech table GS500

## 22 FASTENING BOLTS AND SEALS

Туре	Size	Fastening bolts	Seals
	<b>1</b> = 16	4 socket head screws M8x45 class 12.9 Tightening torque = 35 Nm	2 OR 108
LIMZO LICZO	<b>2</b> = 25	4 socket head screws M12x45 class 12.9 Tightening torque = 125 Nm	2 OR 108
LIRZO	<b>3</b> = 32	4 socket head screws M16x55 class 12.9 Tightening torque = 300 Nm	2 OR 2043
	<b>4</b> = 40	4 socket head screws M20x70 class 12.9 Tightening torque = 600 Nm	2 OR 3043
LIMZO LICZO	<b>5</b> = 50	4 socket head screws M20x80 class 12.9 Tightening torque = 600 Nm	2 OR 3043
LIMZO	<b>6</b> = 63	4 socket head screws M30x90 class 12.9 Tightening torque = 2100 Nm	2 OR 3050
LIWZO	<b>8</b> = 80	8 socket head screws M24x90 class 12.9 Tightening torque = 1000 Nm	2 OR 4075


# 23 COVERS DIMENSIONS [mm]

Size	AxA	ØB	с	D	Port Pp - Dr	
<b>1</b> = 16	65×80	3	4	40	-	
<b>2</b> = 25	85x85	5	6	40	-	
<b>3</b> = 32	100×100	5	6	50	-	
<b>4</b> = 40	125x125	5	6	60	G 1/4"	
<b>5</b> = 50	140x140	6	4	70	G 1/4"	
<b>6</b> = 63	180x180	6	4	80	G 3/8"	Notes: size 1 co
<b>8</b> = 80	ø250	8	6	80	G 3/8"	size 8 co




ze 1 cover is not squared but retangular, dimensions 65x80 ze 8 cover is not squared but circular, dimension Ø250


# (2) Internally terminated

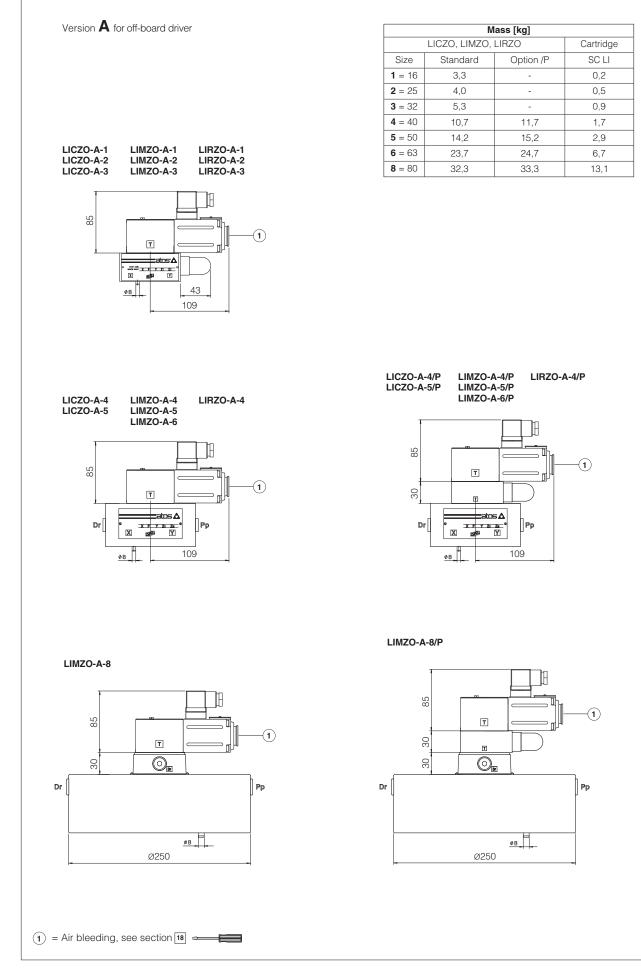

Note: for mounting surface and cavity dimensions, see tech. table P006

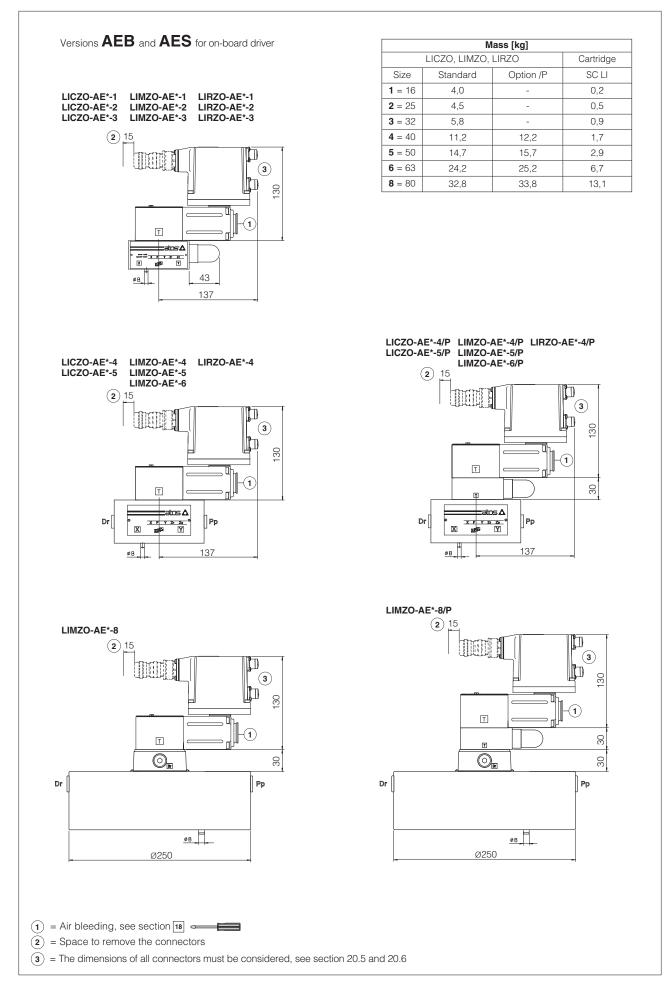

Note: for mounting surface and cavity dimensions, see tech. table P006

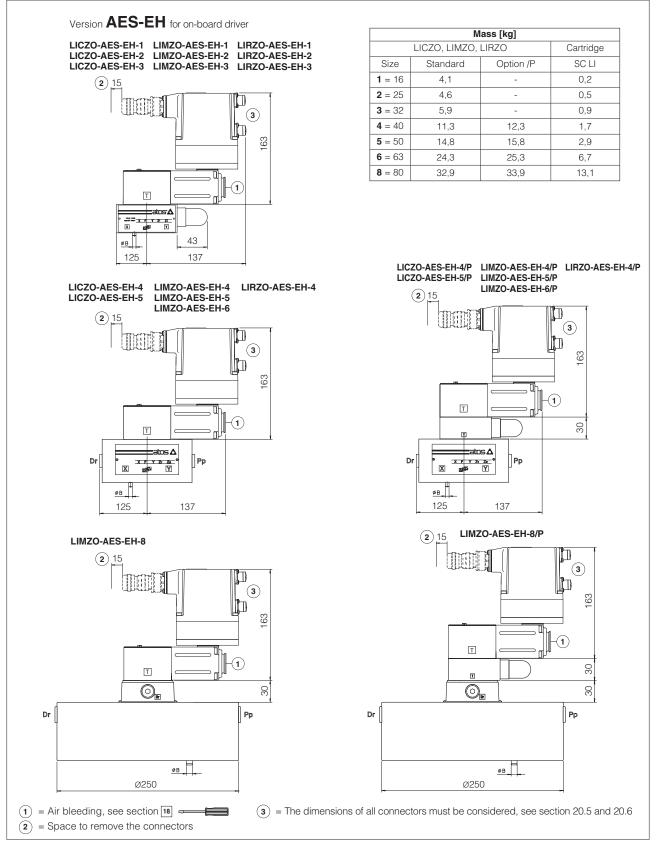

Note: for mounting surface and cavity dimensions, see tech. table P006

# 25 RELATED DOCUMENTATION

FS001	Basics for digital electrohydraulics	GS500	Programming tools
FS900	Operating and maintenance information for proportional valves	GS510	Fieldbus
G010	E-MI-AC analog driver	K800	Electric and electronic connectors
G020	E-MI-AS-IR digital driver	P006	Mounting surfaces and cavities for cartridge valves
G030	E-BM-AS digital driver	QB200	Quickstart for AEB valves commissioning
GS050	E-BM-AES digital driver	QF200	Quickstart for AES valves commissioning